

Review paper on the Design and Implementation of ZONE-1 Distance Protection for a Long Transmission Line for Protection Against Phase to Neutral Fault using IED-REL 670

Aishwarya B G

Department of Electrical and Electronics Engineering, Dayananda Sagar Academy of Technology and Management, Udayapura, Kanakapura main Road, opp. Art of Living, Bangalore-560082, India

B R Lakshmi

Department of Electrical and Electronics Engineering, Dayananda Sagar Academy of Technology and Management, Udayapura, Kanakapura main Road, opp. Art of Living, Bangalore-560082, India

Kavya Bhayya

Department of Electrical and Electronics Engineering, Dayananda Sagar Academy of Technology and Management, Udayapura, Kanakapura main Road, opp. Art of Living, Bangalore-560082, India

Chandu M R

Department of Electrical and Electronics Engineering, Dayananda Sagar Academy of Technology and Management, Udayapura, Kanakapura main Road, opp. Art of Living, Bangalore-560082, India

Kiran.R

Department of Electrical and Electronics Engineering, Dayananda Sagar Academy of Technology and Management, Udayapura, Kanakapura main Road, opp. Art of Living, Bangalore-560082, India

Abstract: This paper stimulates thought on Zone-1 transmission line protection. Voltage and current indications from the transmission line's local terminal are under protection. Within 10 milliseconds of the fault, zone-1 detection is accomplished with 98.4% accuracy. The digital distance relay, which employs symmetrical components of three-phase currents and voltages, is used to safeguard transmission cables fed from one end. The system's power factor is improved by dividing the distance into zones 1, 2, and a transmission line. Based on the use of an artificial neural network, decide whether a defect exists in the given line length in almost real-time. Transmission line protection is provided by electromechanical distance relays. The operation of the distance protection relay during a malfunction on a transmission line with series compensation is examined. It describes how the relay created, together with shunt reactor correction, was used to a 645 km long, 1000 kV UHV transmission line. To further demonstrate how successfully distance protection functions with the distribution system, this research incorporates information from real-world event reports.

Keywords: Networks; Transmission; Analysis; Electromechanical; Power Factor

1. Introduction

Distance or impedance protection is the most fundamental and common protection used in high-voltage power transmission systems [2]. Determine if the fault is within the zone to be protected. Different types of problems such as short circuits, noise effects, and others are occurring in power system networks, and due to these short circuits' heavy current flows through the equipment working in the system causing damage to the equipment [1]. In order to maintain the system's stability and to improve its reliability, fault detection, and rapid equipment mechanism present in the system [3] [4].

The study investigated the feasibility of distance protection in extra voltage networks for relativity long EHV transmission lines a major problem in existing distance production is that the major independence of importance relay may not be proportional to the fault distance study analyzed this problem in detail through theoretical analysis.

Variable filtering algorithm improves operating speed without sacrificing security. An adaptive polarizing scheme accommodates rapidly changing system conditions [5]. This paper deals with distance protection elements based on quadrilateral operation characteristics. An alternative method to solve the optimization problem related to the determination of the reach settings of the quadrilateral distance protection element of mutually coupled transmission lines is proposed. Electromechanical distance relays used for the production of transmission linear prone to the effect of resistance in each part condition improve the relay performance this paper presents a new approach to the Artificial Neural Network to overcome the effect of heart resistance on relay operation consequently the decision made by a relay will

not be seriously affected by variation in system parameters. Figure 1 illustrates the system model of the power system network.

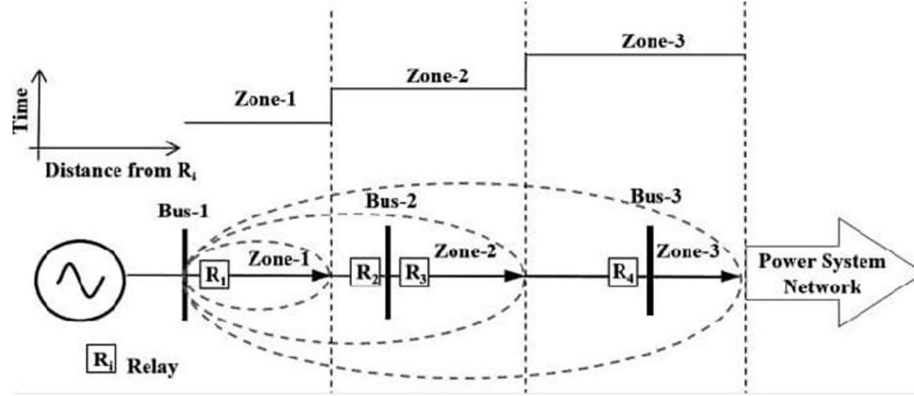


Fig.1. Power System Network

It is frequently possible to boost the electrical transmission capacity of a transmission line by utilizing series compensation. However, there is a limit to how much compensation may be applied to a line since protection settings are frequently impacted when compensation surpasses 50% of the line impedance coordination.

In order to increase distributed shunt capacitance and raise natural power while lowering corona losses on the conductor surfaces, line designs frequently minimize characteristic impedance. As a result, a distance relay system will likely need a more accurate model rather than a depiction of the UHV transmission line using lumped parameters. The apparent impedance is determined by a distance relay using locally recorded current and voltage. The impedance of a transmission line is normally spread uniformly over its length.

There is typically a primary trunk on a distribution feeder from which branch circuits sprout. These laterals are often connected to the main trunk via a fuse. The feeder protection for a fused lateral is designed to ensure that a permanent fault will only result in an outage for that lateral. For longer feeders with midline reclosers, the feeder protection is set up to prevent tripping of the source breaker for faults downstream of the recloser.

2. System and Methods

2.1 Numerical Relays

A numerical relay is a computer-based system with software-based protection algorithms for the detection of electrical defects in utility and industrial electrical power transmission and distribution systems. These relays are also known as protective microprocessor relays [6]. They can provide various protective functions in one unit, as well as metering, communication, and self-test features. They are a functional substitute for electro-mechanical relays. The physical depiction of numerical relays is shown in Figure 2. Additionally, it is known as Intelligent Electronic Devices (IED), numerical relays.



Fig.2. Electro-Mechanical Relay

2.2 PCM Software

To interface with IED in this project, PCM600 software is utilized. The IEDs' built-in protection relays are microprocessor and microcontroller based, therefore activating that feature requires some programming or setting. PCM software can be used to complete this setting [7].

2.3 Secondary Injection Kit

It is a relay test kit that gives the relay's CT and PT inputs. Both current and voltage channels are present. A current knob included in the kit will be used to regulate the current inputs to the relay. Utilizing the voltage knob included in the kit, the voltage input to the relay will be managed. In order to know when the relay is operating, it also has a one-timer. The illustration shows an ordinary secondary injection kit, which is exhibited in Figure 3.



Fig.3. Secondary Injection Kit

2.4 Distance Protection

The functional block diagram for distance protection is shown in Figure 4..

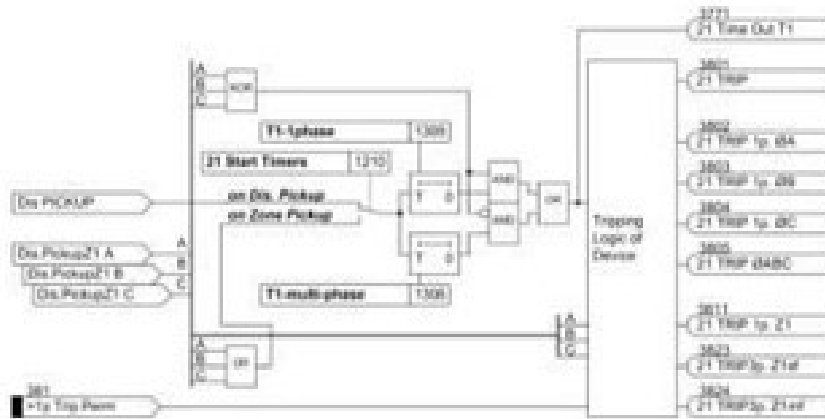


Fig.4. Functional Diagram

The REL670 relay's primary protective feature is distance protection. High measuring precision and adaptability to the existing system circumstances define it. It is enhanced with a variety of other features.

2.5 Quadrilateral Characteristics

The quadrilateral properties as depicted in figure 5 are the foundation upon which the distance protection operates. The protection activates and sends the trip command to CB after a predetermined time delay if the measured impedance satisfies the quadrilateral specifications as shown in Figure 5.

2.6 Design and Implementation

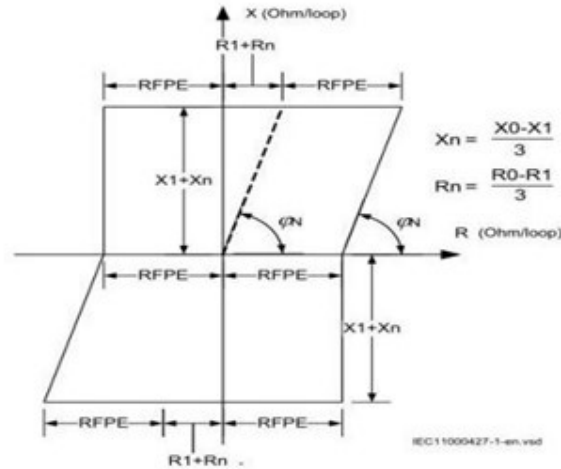


Fig.5. Zone-1 Characteristics

In the figure-6 represents the design of zone-1 distance protection to protect the 100km, transmission line

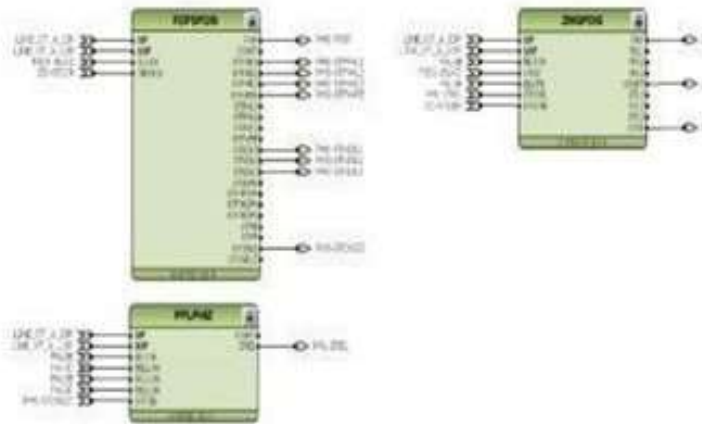


Fig.6. Design of Distance Protection

3. Review

To stop the unintended effects of a fault, power transmission lines can use network-based impedance protection. an algorithm to find faults and decide whether they are within a certain distance of the transmission line. The impedance for zone 1 is limited to under 25 ohms. The relay will communicate that a fault has occurred in zone 1 if it detects a fault impedance below 25 ohms. The outputs of networks' reactions when faults occurred at various fault parameters. When a single line to ground fault occurs, the time signals for voltage and current courses that were utilized as input for fault classification are used.

An in-depth analysis was done on the issue of the measured impedance in long EHV transmission lines not being proportional to the fault distance. Due to CVT transients, the Zone 1 distance element does not overflow. Secure ways to shorten communications aided tripping schemes' total protection tripping times. This research discusses the use of an Ain and a categorized spectrum to enhance the performance of distance relays. They utilized Simulink while we use PCM 600 for simulation. While we are employing quadrilateral qualities, they had been using mho characteristics. When resistance is present, the relay's performance suffers [8]. Distance protection components with series compensation have exceptional line impedance, which could lead to relay failure. Subharmonic oscillations and non-linearity of the line impedance are two issues caused by the series compensation of transmission lines. The reported results are pertinent to how the distance relay behaves in fault conditions on a 400 kV series compensated line. The investigation is carried out in an industrial Digsilent Power setting. To determine whether a problem

is inside or outside the protection zone, the distance relay system integrates a distributed parameter line model based on steady-state transmission line equations. Experimental testing is carried out using an RTDS (real-time dynamic system), which faithfully simulates a 645-km, 1000-kV UHV transmission line.

Some of the elements of distance protection include the concepts of amplitude and phase comparators to construct a distance relay, the foundations of measuring the distance to fault based on electrical signals from one end of the circuit, and others. the various techniques used to build long-distance relays.

When integrating Distributed Generation (DG) or dispersed resources, an electrical power system owner or management faces technical obstacles. With the addition of relatively significant volumes of generation to the distribution system, the historical setup tenets and present design presumptions may be in peril.

The necessity for and complexity of additional safety and control systems increases the total DG capacity inside a potential island approaches or matches the load inside island. It is also crucial to consider how DG availability and fault current capability evolve over time. Some of the key issues addressed and associated with DG on the distribution feeder include anti-islanding, transitory over-voltages under fault conditions, and loss of sensitivity of the feeder over current management for long feeders [9].

LITERATURE REVIEW

RefNo.	Title	Author	Year of Publication	Findings	Outcomes
[1]	"Advanced Transmission Protection"	G Benmouyal, N Fischer, AGuzman, J Mooney, and D Tziouvaras	2004	IEEE	In this paper, the authors provide the high-speed distance element performance, a series-compensated transmission line method to prevent Zone 1 element overrun and a frequency estimation technique to ensure accurate frequency tracking under pole-open situations to avoid relay malfunctions.
[2]	"Fundamental of distance protection"	Bogdan Kasztenny, Dale Finney	2008	IEEE	The document explains electromechanical, static, and digital distance relay technologies as well as basic guidelines for implementing distance comparators (phase and amplitude comparators). The source impedance ratio, transient accuracy, and speed of operation are highlighted as elements affecting the performance of distance relays.
[3]	"A Distance Protection Relay for a 1000-kV UHV Transmission Line"	Z. Y. Xu, S. F. Huang, Li Ran	2008	IEEE	The method of accurately measuring fault impedance and configuring the relay, as well as a new line model for a distance relay, are presented in this work. It outlines the relay's intended use in connection with a 645-km, 1000-kV UHV transmission line, which includes shunt reactor compensation.
[4]	"Innovative solutions improve transmission line protection"	Daqing Hou, Roberts	2008	Research Gate	For the CVT transients, the Zone 1 protective feature does not go too far.
[5]	"Distance Relay Element Design"	E. O. Schweitzer, III, and Jeff Roberts	2010	Research Gate	Basic distance and directional element design are presented in this work. Relationships between the more recent digital and numerical technologies and the traditional electromechanical and static-analog ways of developing relay components are stressed heavily.
[6]	"Distance Protection Scheme For Protection of Long Transmission Line Considering the Effect of Fault Resistance"	A.P.Vaidya & Prasad A.Venikar	2012	IEEE	This research discusses the application of an ANN as a pattern classifier to enhance the performance of distance relays. If a pattern correlates to a fault or no-fault state, the neural network can identify it. Additionally, the network is able to identify the operational zone in

[7]	"Distance Protection Based on Artificial Neural networks Author: Libor Straka,"	Libor Straka	2014	IEEE	the event of a fault scenario. This work discusses the usage of an ANN as a pattern classifier to enhance distance relay performance. Whether a pattern relates to a fault or no-fault situation can be determined by the constructed neural network. The network is also capable of determining the operating zone in the event of a fault scenario.
[8]	"Distance Protection in Distribution Systems: How It Assists With Integrating Distributed Resources"	Amy Sinclair	2014	IEEE	This study examines how the distance protection relays on a transmission line with series compensation behave when there is a malfunction. Series compensation causes distance protection components to have unusual line impedance, which might cause the relays to malfunction. An issue brought on by the series compensation of transmission lines is the occurrence of sub-harmonic oscillations and non-linearity of the line impedance.
[9]	"Improved zone 1 top-line tilting scheme for the polygonal distance protection in the outgoing line of type-4 wind parks"	Hans Kristian Senior Member, IEEE	2014	IEEE	This work discusses the usage of an ANN as a pattern classifier to enhance distance relay performance. Whether a pattern relates to a fault or no-fault situation can be determined by the constructed neural network. The network is also capable of determining the operating zone in the event of a fault scenario.
[10]	"Distance Protection: Why Have We Started With a Circle, Does It Matter, and What Else Is Out There?"	Edmund O. Schweitzer and Bogdan Kasztenny	2017	IEEE	The history of distance element design is reviewed, the operating principles are explained, implementation details are shared, and test results and real-world examples are presented. These show that distance element design has a significant operating time advantage over its more conventional competitors.
[11]	"Zone Protection System of Transmission Line by Distance Relay using Matlab/Simulink"	Farhana Ferdous	2018	IEEE	Because they can be taught using offline data, neural networks are advantageous for power system applications. Present are the network outputs for the 80 km single line to the ground fault
[12]	"Machine Learning Based Setting free Reach Element For Zone-1 Distance Protection"	Neethu George, P. Suraj Nath	2019	IEEE	The input measurement is made using incremental voltage and current readings from the relay's local terminal. The neural network is trained using characteristics of the incremental voltage and current variables, such as the slope of the rising edge and the rise time of the initial peak.
[13]	"Distance protection of EHV long transmission lines"	Wang Jiang, Jiping Xing Ma, Hui Fang	2019	State Grid Chongqing	The practical issues that came up when distance protection was applied to EHV long transmission lines were listed. An in-depth analysis was done on the issue of the observed impedance in long EHV transmission lines not being proportional to the fault distance.
[14]	"Calculation of distance protection settings in mutually"	Serna Jaramillo & Jesus Maria Lopez Lezama	2019	Energies	In this paper, the authors are utilizing single-circuited lines as opposed to double-circuited lines. The only

	coupled transmission line: A comparative analysis."				difference in the application is the computation.
[15]	"The performance of distance protection relay on series compensated line under fault conditions"	X.G. Magagula, D.V.Nicolae, A.A. Yusuff	2021	IEEE	This study examines how the distance protection relays on a transmissionline with series compensation behave when there is a malfunction. Series compensation causes distance protection components to have unusual line impedance, which might cause the relays to malfunction.
[16]	"Settings Considerations for Distance Elements in Line Protection Applications"	Bogdan Kasztenny	2021	IEEE	This paper examines applications for zone 1, zone 2, and reversal zones. It also provides a more thorough application of zone 1, ground, and phase distance elements in weak systems and explains why distance protection application in such systems faces extra obstacles.

4. Conclusion

Transmission line ZONE-1 distance protection was discussed in this work. Incremental quantities of voltages and currents from the local terminal where the relay is located are used as the input measurement. The study of basic faults generally occurs in the transmission line of a power system and their protection scheme using the distance relay. Here an 11kv transmission line is taken into consideration and a Simulink model is designed for the line by MATLAB/Simulink. The practical problems encountered in the application of distance protection in EHV long transmission lines were specified. The developed neural network is able to detect whether the pattern corresponds to a fault or no-fault condition. In addition to this, if there is a fault condition, the network is also able to determine the zone of operation.

Compliance with Ethical Standards

Conflicts of interest: Authors declared that they have no conflict of interest.

Human participants: The conducted research follows ethical standards and the authors ensured that they have not conducted any studies with human participants or animals.

References

- [1] L. Straka and G. Fandi, "Distance protection based on Artificial Neural Networks"
- [2] Neethu George;P. Suraj Nath;O.D. Naidu;Preetham Yalla, 2019
- [3] Farhana Ferdous;Ruma, 2018 International Conference on Advancement in Electrical and Electronic Engineering
- [4] Kaiqi Ma, Hans Kristian Høidalen, *Senior Member, IEEE*,
- [5] A.P. Vaidya & Prasad A. Venikar Department of Electrical Engineering, Walchand College of Engineering
- [6] Distance protection of EHV long transmission lines"
- [7] "Innovative solutions improve transmission line protection" (daqing Hou, Armando Guzman, Jeff Roberts)
- [8] Calculation of distance protection settings in mutually coupled transmission line: A comparative analysis" (serna Jaramillo & Jesus Maria Lopez Lezama)
- [9] "Distance Protection Scheme For Protection of Long Transmission Line Considering the Effect of Fault Resistance" A.P. Vaidya & Prasad A. Venikar
- [10] Settings Considerations for Distance Elements in Line Protection Applications" by Bogdan Kasztenny Schweitzer Engineering Laboratories, Inc.
- [11] E. O. Schweitzer, III and B. Kasztenny, "Distance protection: Why Have We Started With a Circle, Does It Matter, and What Else Is Out There?" proceeding of the 71st Annual Conference for Protective Relay Engineers, March 2018.
- [12] Advanced Transmission Protection" by G Benmouyal, N Fischer, A Guzman, J Mooney, and D Tziouvaras by IEEE

- [13] Distance Relay Element Design" by E. O. Schweitzer, III, and Jeff Roberts in 2010 by research gate
- [14] The performance of distance protection relay on series compensated line under fault conditions" by X.G.
- [15] Magagula, D.V. Nicolae, A.A. Yusuff
- [16] A Distance Protection Relay for a 1000-kV UHV Transmission Line" by Z. Y. Xu, S. F. Huang, Li Ran
- [17] Fundamentals of Distance Protection" by Bogdan Kasztenny Dale Finney
- [18] Distance Protection in Distribution Systems: How It Assists With Integrating Distributed Resources" Amy Sinclair.